

Energy efficiency in alumina refineries - Combining hydrate filtration with alumina calciner

Michael Missalla¹, Andreas Koschnick², Linus Perander³, Hans Werner Schmidt⁴

1. VP Products and Technologies of Outotec,

2. VP Light Metals

3. Product Manager - Calcination and affiliation of Outotec

4. Senior Consultant of Outotec

Corresponding author: michael.missalla@outotec.com

Abstract



Energy efficiency in modern alumina refineries is one of the key parameters for the economic success of the plant. Roughly one third of the overall energy consumption of the alumina refineries is coming from the calcinations area. Recently the introduction of the CircoCal™ has further proven to increase the energy efficiency of Circulating Fluidized Bed (CFB) calcination plants. Nevertheless there are further options to improve the energy efficiency via combining the calciner with the hydrate filtration section. Outotec has constructed many of its calcination plants with integrated hydrate filtration. The advantages for operation and combined improvement of energy efficiency are shared below. Besides the operational advantages also the effect for new installations will be explained.

Keywords: Energy Efficiency, alumina calciner, alumina refineries, hydrate filtration, plant combination.

1. General

The specific energy consumption from the refining of alumina with the Bayer process from Bauxite currently spreads from 21 GJ/tonne to 7 GJ/tonne using a wide array of digestion and calcination techniques, which are the two main energy consumers in the Bayer process. Both can constitute up to almost eighty percent of refinery thermal energy consumption. [6]

Since the development of circulating fluidized bed technology for the calcinations of alumina in the 60s the reduction of energy consumption continued. The reduction in energy consumption was achieved by recovering the heat from the claimed product and the waste gas flow more efficiently. This evolution progressively decreased the energy consumption (see figure1) [1]. The latest achieved specific energy consumption reached was already below 2700 kJ/kg Alumina [2, 3]. It should be mentioned that this was a revamp to a plant which was at that time already in operation of some 40 years.

Further operational benefits and costs savings can be achieved through automation improvements [4] and inclusion of equipment for energy reduction such as hydrate bypass and/or hydrate dryer [5].

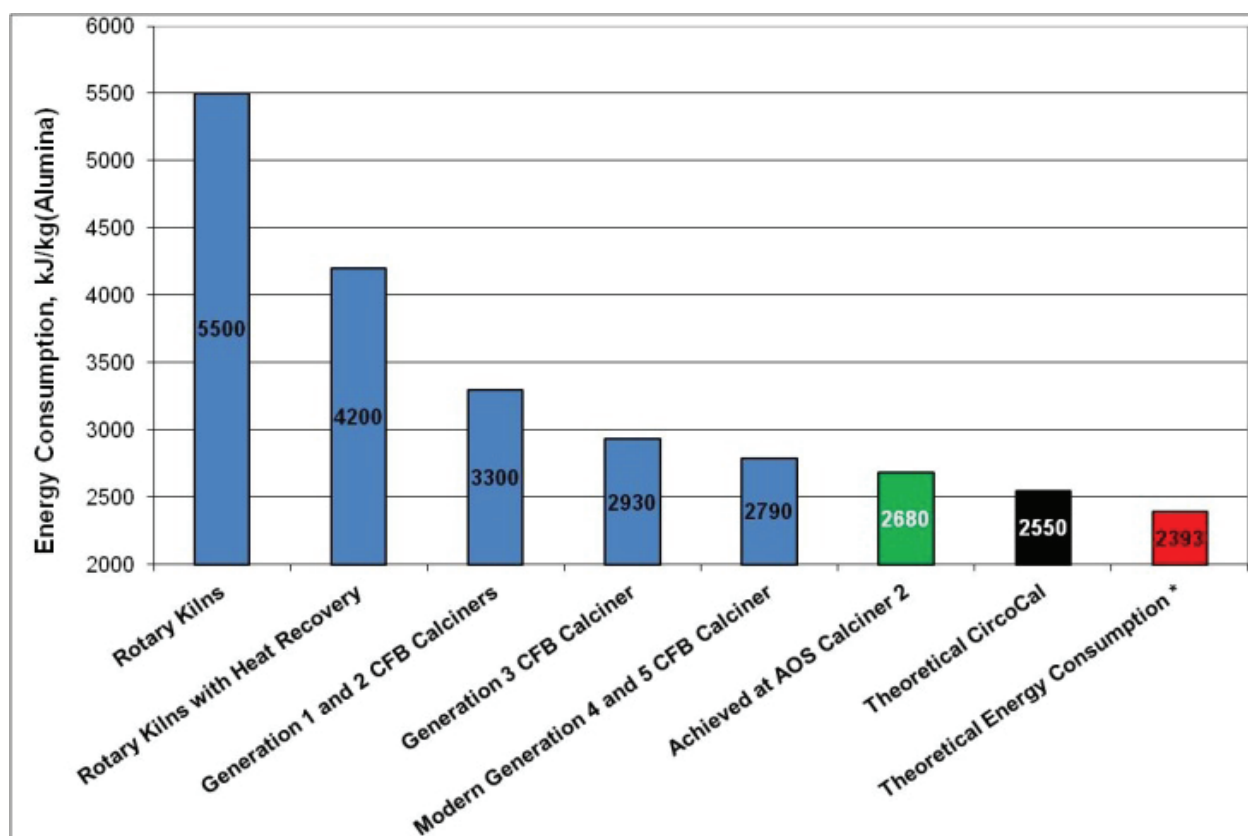


Figure 1. Energy efficiency at different installations [1].

* Note: The Theoretical Energy Consumption is based on a hydrate moisture of 6 %.

2. Combining hydrate filtration with alumina calciner

The thermal efficiency of the CFB calciner taking heat losses into account is more than 95 %. Even considering insulating the stationary calciner, the potential for energy saving by reducing heat losses is minimum. However the main sources contributing to less efficiency are:

- 1 – Heat loss with the waste gas .77 GJ/t Al_2O_3
- 2 - Heat loss with cooling .35 GJ/t Al_2O_3

The recovery of the waste gas loss is very complicated and capital intensive. To minimize the gap to the theoretical specific energy consumption in the calcination area further heat exchanging stages might be necessary [5].

The potential of the cooling water of approx .35 GJ/t Al_2O_3 and can be recovered by moderate efforts e.g. the preheating of filter wash water, incorporation of hydrate dryer, production of low pressure steam for example for steam hoods etc. A hydrate dryer was recently incorporated in one CFB alumina calciner, helping to reduce the specific fuel consumption to less than 2.7 GJ/t alumina

The above mentioned measures to utilize the potential to save energy with the cooling water, has the added benefit that they also reduce the moisture with the hydrate feed. This moisture reduction in itself also reduces the specific fuel energy consumption, up to approx 30 kJ/kg Al_2O_3 calcined. This implies that the total energy saved can be greater than just that of reducing energy wasted with the cooling water.



Figure 4. Integrated hydrate filtration and calcinations plant.

3. Conclusion

Decreasing of the overall energy consumption in alumina refineries is playing an important role. It will determine the financial viability of the refinery throughout the lifetime. The presented option to combine the hydrate filtration with the alumina calcination will help to reduce the energy consumption in refineries. In Greenfield projects it will even positively affect the installation costs.

4. References

1. Klett Cornelis, Perander Linus ALUMINA CALCINATION: A MATURE TECHNOLOGY UNDER REVIEW FROM SUPPLIER PERSPECTIVE, Light Metals 2015 pp 79-84.
2. Perander Linus, Lalla Andre, Klett Cornelis, Reeb Bernd, Petersen Birger, Missalla Michael, Guhl Eberhard APPLICATION OF OPTIMIZED ENERGY EFFICIENT CALCINATION CONFIGURATION TO AOS STADE CFB CALCINERS, AQW 2012 Paper.
3. Perander Linus, L. Keller, C Klett, and M. Missalla, CircoCal™ – Pushing Energy Efficiency to its Limit in Circulating Fluid Bed Calcination, ICSOBA Conference Proceedings, 2012.
4. Cornelis Klett, Bernd Reeb, Michael Missalla, Hans-Werner Schmidt, Methods to Reduce Operating Costs in Circulating Fluidized Bed Calcination, Light Metals 2011 pp 125-130.
5. Linus Perander, Ioannis Chatzilamprou, Cornelis Klett, Increased Operational Flexibility in CFB Alumina Calcination, Light Metals 2014, pp 49-54.
6. Alessio Angelo Scarsella et.al., Energy in Alumina Refining –Setting new limits Light Metals 2015.